



DATA SHEET

revision date
24.06.2024

product code

20.10.00.00

Satellite Clean FOAM ONE WD



304




MATERIAL	Stainless Steel housing and connections
WEIGHT	4 kg
MAX. DIMENSIONS (WxHxD)	218 x 311 x 98 mm
MOUNTING HOLES DIAMETER AND SPACING (WxH)	Ø7 mm; 155 x 155 mm
DOSING RANGE	0,3-7%
MIN. WATER FLOW FEED INLET	30 l/min
WATER INLET	EXT 1/2"
WATER OUTLET	Female quick coupling 1/2"
MIN. WATER PRESSURE NEEDED TO FOAM	5 bar
WATER PRESSURE	3,5 - 10 bar
AIR OUTLET	ø6 mm
MIN. AIR FLOW (FEED)	150 l/min
AIR PRESSURE RANGE	2 — 6 bar
NUMBER OF PIECES IN THE PACKAGE	1
PACKAGE DIMENSIONS (WxHxD)	-



Clean **FOAM ONE WD**

- Possibility to install the satellite on a wall or on a trolley
- Satellite for 1 chemical agent (foaming or disinfecting).
- It is recommended to maintain constant water pressure (min. 3.5 bar). For this purpose, you can use a hydrophore set with a regulator
- The dosing of the chemical agent takes place through the nozzle.
- Laser marking available on request.
- Easy to use with a reliable manual control mechanism (functions: chemical agent / rinse).
- Protection of service elements against unauthorized access
- Durable, safe and hygienic stainless steel housing.
- The sloping roof and the bottom of the satellite (15°C) prevents accumulation of sediments.
- Chemical agent, water and air suction inlets are secured with stainless steel check valves.

TECHNICAL DRAWING WITH DIMENSIONS

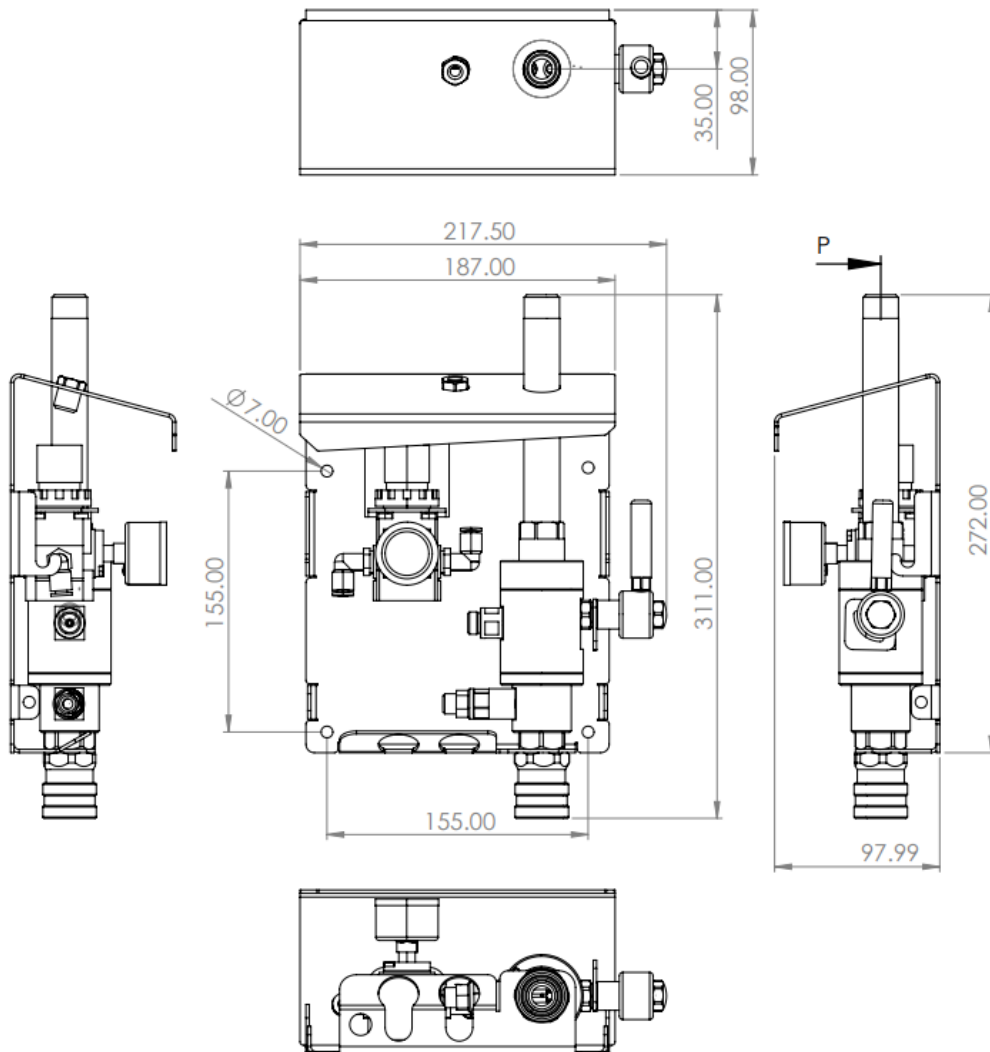



CLEANACCESS

FOOD HYGIENE EQUIPMENT



MAINTENANCE

The housing is made of stainless steel. Its anti-corrosion properties depend on the conditions in which the steel is used and its maintenance. Stainless steel products should be cleaned, dried and maintained with products intended for this purpose. Particular attention should be paid to the regime of cleaning products used in an environment of high salinity or humidity, so as not to accumulate sediment.

Attention! EVERY TIME AFTER WORKING, RINSE THE DEVICE USING THE WATER!

The suction tube, which takes the chemical preparation from the canister, should be immersed in clean water and the device should be started in the FOAM phase until clean washings are obtained at the exit of the foam lance.
