



DATA SHEET

revision date
18.09.2024

product code

20.03.00.10.P


Central Dosing Point CDP 100/10FSP



WEIGHT	112 kg
MAX. DIMENSIONS (WxHxD)	500 x 1728 x 791 mm (dimensions of Dosing Pump: 208 x 388 x 365 mm)
MAX. NUMBER OF USERS	10
MIN. WATER FLOW FEED	120 l/min
WATER INLET	EXT 1 ¼"
WATER OUTLET	EXT 1 ¼"
MAX. WORKING PRESSURE	13 bar
PRESSURE (FEED)	2-10 bar
MAX. WATER TEMPERATURE (FEED)	30° C



NOMINAL ENGINE POWER	6 kW
BASIC FREQUENCY	50 — 60 Hz
NOMINAL VOLTAGE	3 x 380-415D V
DOSING RANGE	0,3 — 3 L/min
NUMBER OF PIECES IN THE PACKAGE	1
NUMBER OF PIECES ON THE PALLET	1

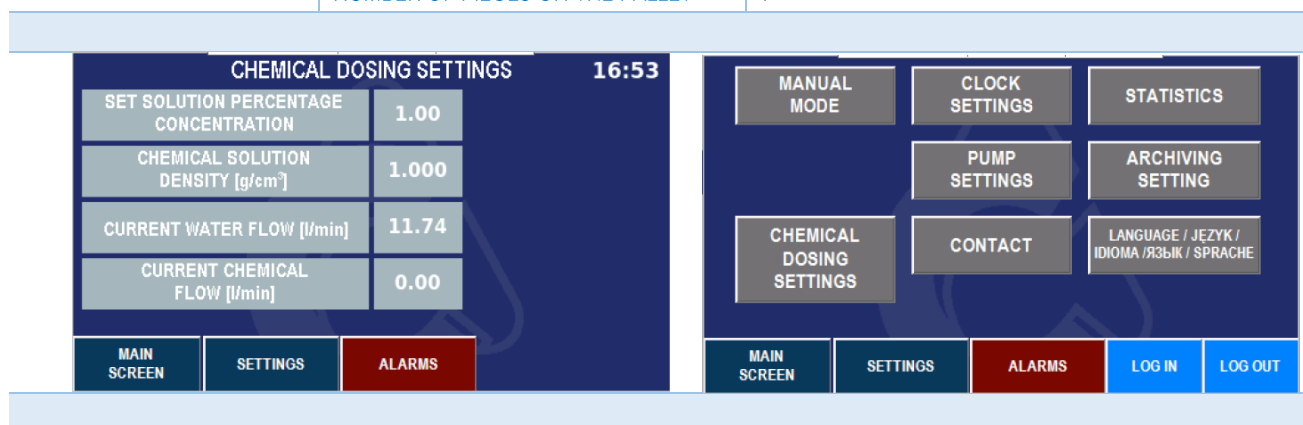

- Equipped with a Grundfos pump - one of the leading manufacturers of such solutions in the world.
- Equipped with a dosing pump concentrated preoperation.
- The solution in the pipe consist of proportional dosing of a concentrated chemical preparation to the incoming water.
- Equipped with dry-running protection and overheating.
- Equipped with an inverter, which enables flexible operation of the device and reduces energy consumption.
- Central Point equipped with a PLC controller with a touch screen.
- Possibility of archiving device errors.
- Equipped with protection against working on an empty tank.
- In e-option — full reporting of media consumption.

Additional options:

- Possibility to install drivers other than those provided by CleanAccess according to customer requirements.
- Possibility of remote connection to a computer and data transfer.
- Equipped with a flow meter and archive water consumption readings.
- Equipped with chemical flow meter and archive chemical consumption readings.
- Equipped with energy consumption meter.
- Possibility of connecting an internet modem in order to remotely connect to the device.

MAINTENANCE

The non-return valve and filter should be checked at least once a month. Depending on the degree of wear, It is recommended to replace them at least once a year.

The Central Dosing Point should only be installed in locations where ambient temperature above 0°C is guaranteed. The equipment should be protected against temperatures below freezing, as this may cause water freezing in the system and its damage. If there is a known risk of temperature dropping below freezing, immediately remove all water from the system.